

SCALE: HOR. 1"= 40'
VERT. 1"= 4'

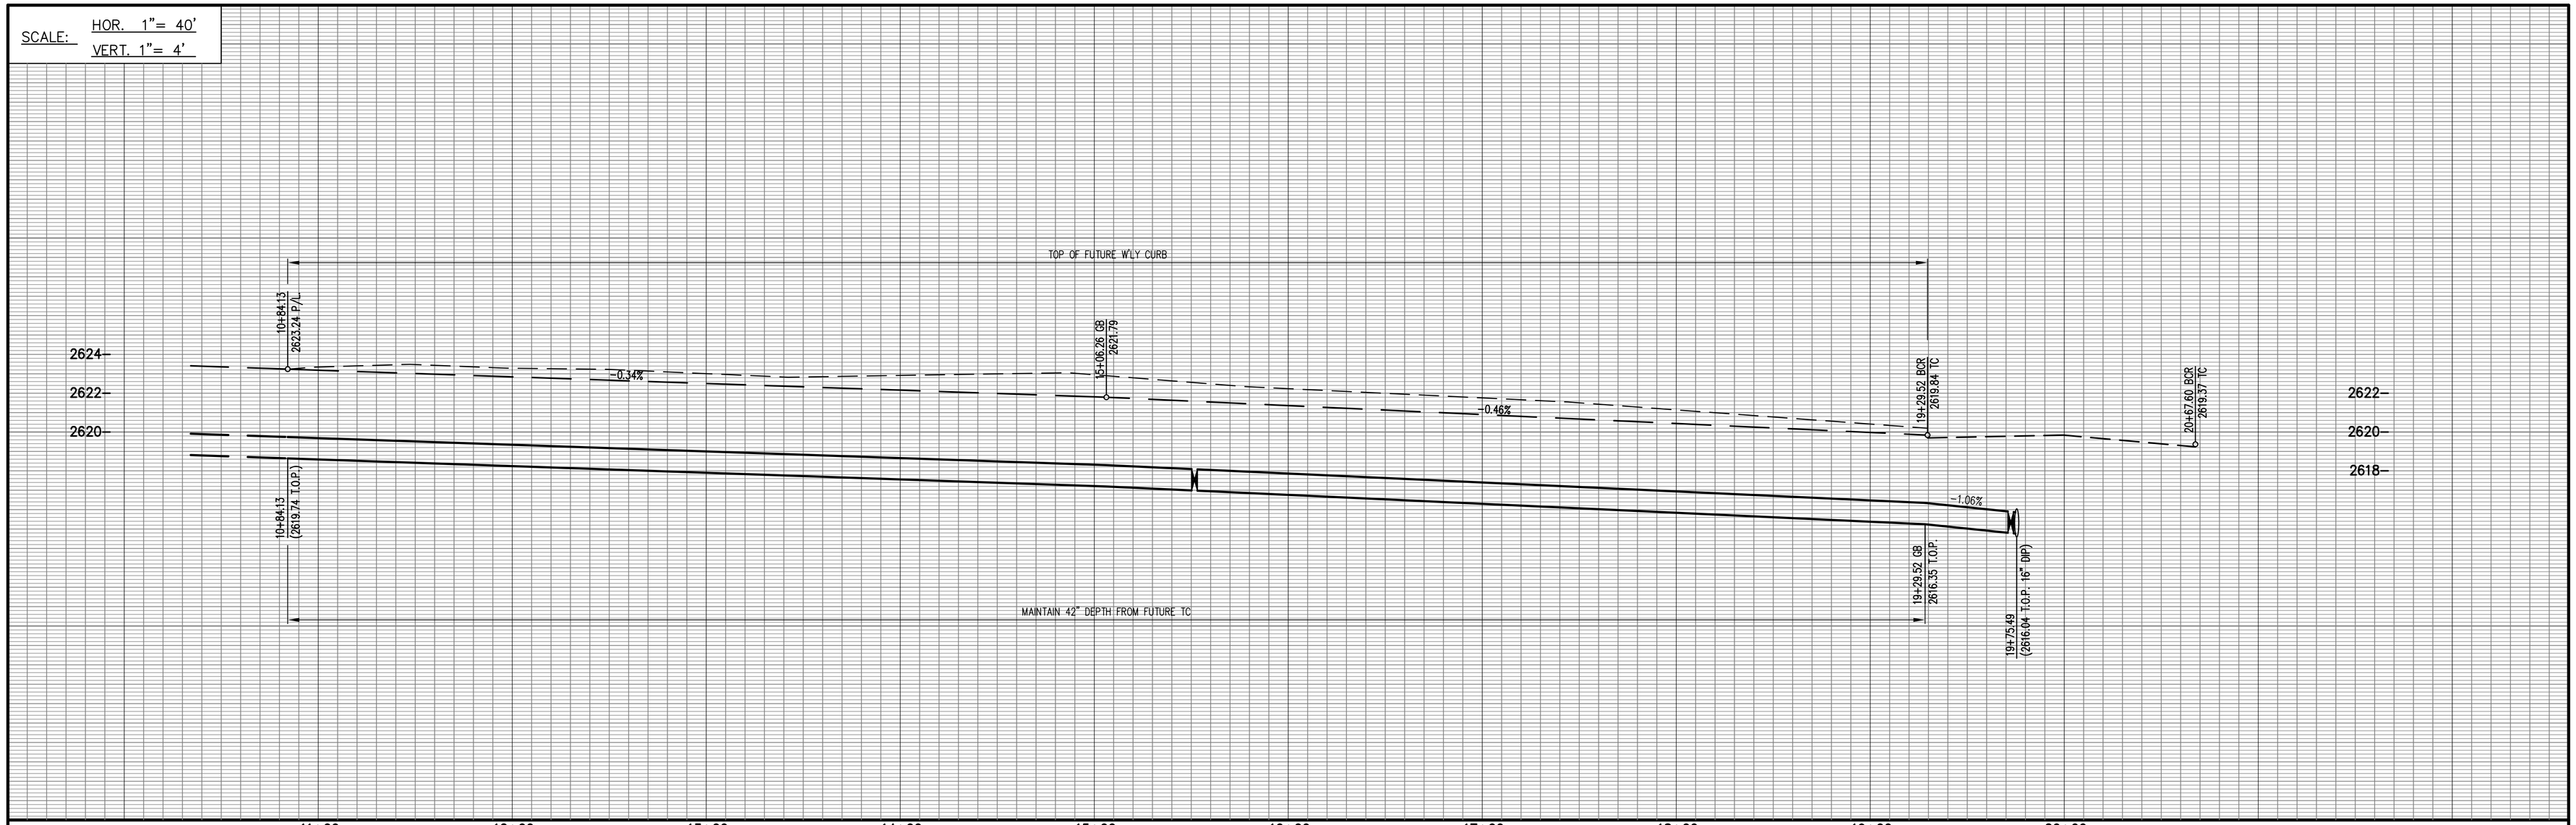

J1 UNDER DISTRICT SUPERVISION CLOSE VALVE "A". REMOVE EXIST. PLUG AND BLOW-OFF ASSY. AND JOIN WITH MATERIAL SHOWN. SHUT-DOWN NOT TO EXCEED 2 HOURS.

J2 UNDER DISTRICT SUPERVISION HOT TAP EX. 16" DIP AND JOIN WITH MATERIAL AS SHOWN.

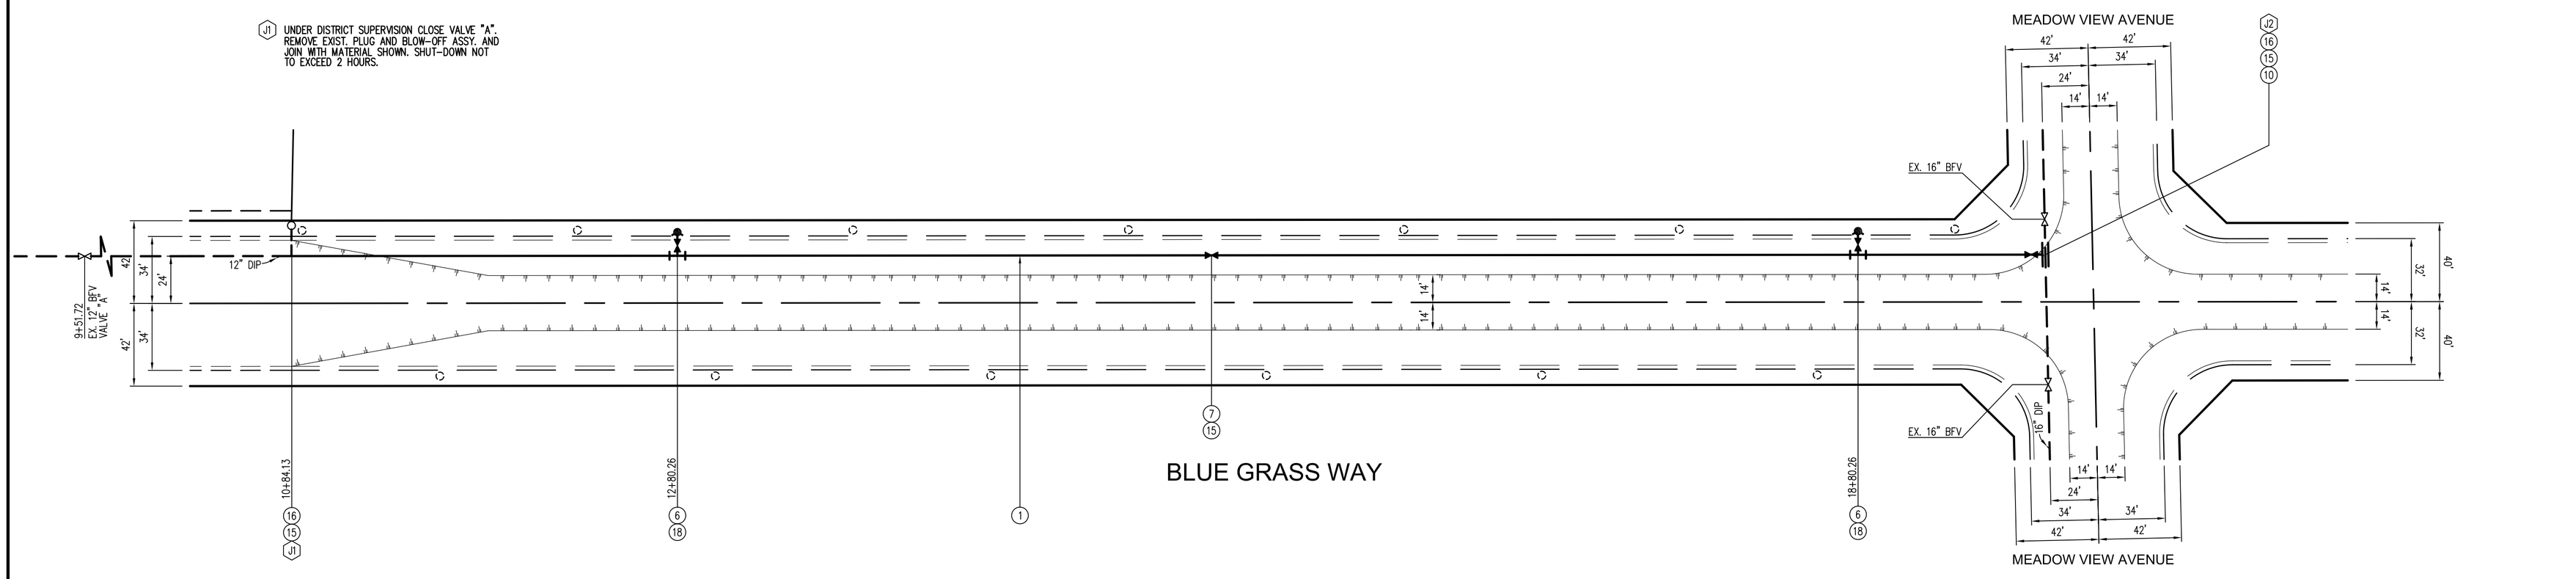

GRAPHIC SCALE: 1"=40'

NO.	REVISIONS	DATE	BY

DEVELOPER INFO
NAME, ADDRESS, PHONE

REGISTERED CIVIL ENGINEER STAMP

ENGINEERING FIRM INFORMATION
NAME, ADDRESS, PHONE, FAX, ETC.

NAME DATE

PALMDALE WATER DISTRICT

APPROVED BY:

PALMDALE WATER DISTRICT DATE

WATER SYSTEM IMPROVEMENTS

BLUE GRASS WAY

FROM 10+84.13 TO 19+75.49

WSM NO. 46-87 | TRACT 91770 | SHEET: 4 OF 10